

BMA0600 Input module

Application

The input module with 6 analog inputs receives analog signals in the DDC4000e automation system.

LED displays for the operating states of the inputs.

Communication is controlled via LED.

Label carrier for system-specific description.

The power supply and the CAN bus are electrically isolated.

Data is transferred between the automation station and the input module via the CAN bus.

The input module can be connected to an existing switch cabinet bus or field bus.



Content	Page
Important Information on Product Safety	2
Item	3
Technical Data	3
Dimensions	5
Connection	5
Installation	7
Mounting	8
Removal	8
Function and Operation	9
Commissioning	10
LED displays	11



Important Information on Product Safety

Safety instructions

This document contains information on installing and commissioning the product “BMA0600”. Each person who carries out work on this product must have read and understood this document. If you have any questions that are not resolved by this document, you can obtain further information from the supplier or manufacturer.

If the product is not used in accordance with this document, the protection provided could be impaired.

The applicable regulations must be observed when installing and using the devices. Within the EU, these include regulations regarding occupational safety and accident prevention as well as those from the VDE (German Association for Electrical, Electronic & Information Technologies). If the device is used outside of the EU, it is the responsibility of the plant engineer or operator to comply with local regulations.

Mounting, installation and commissioning work on the devices may only be carried out by qualified technicians. Qualified technicians are persons who are familiar with the described product and who can assess given tasks and recognize possible dangers based on their technical training, knowledge and experience, as well as their knowledge of the applicable regulations.

Symbol meanings



WARNING

Indicates a hazard of medium risk which can result in death or serious bodily injury if not avoided.



CAUTION

Indicates a hazard of low risk which can result in minor or medium bodily injury if not avoided.



CAUTION

Indicates a hazard which can result in material damage or malfunctions if not avoided.



NOTE

Indicates additional information that can simplify working with the product.

Notes on disposal

In accordance with the applicable laws and directives of the European Union countries, the product should not be disposed of with household waste. This ensures environmental protection and sustainable recycling or raw materials.

Commercial users should contact their supplier and observe the conditions of the purchase agreement. This device may not be disposed of together with other commercial waste.

The local and currently applicable laws must be observed.



Item

BMA0600 Input module with 6 analog inputs

Technical Data

Nominal voltage	12..24 V DC \pm 10 %; 2.5 W
Inputs and outputs	<ul style="list-style-type: none"> ■ 6 analog inputs, See chapter "Sensor Types", page 4. ■ separate auxiliary power (terminal 53, 56) 10 V DC; Σ 70 mA for connecting external setpoint generators ■ Support terminal blocks terminal "81" to "86" and terminal "91" to "96" max. load 230 V AC; 6 A (3 A)
Indicators and controls	<ul style="list-style-type: none"> ■ 6 status LEDs of inputs ■ 6 freely parameterizable LEDs ■ 1 LED for displaying bus communication <p>See chapter "LED displays", page 11.</p>
Address switch	Two rotary switches for addressing from 01..63
Interfaces	<p>CAN bus as:</p> <ul style="list-style-type: none"> ■ Fieldbus, F-bus: 2000 m, 20 kBaud or ■ Switch cabinet bus, SBM bus: 200 m, 40 kBaud (note special CAN BUS settings. Further information can be found in the DDC4000 project planning documentation)
Housing	Plastic housing
Overvoltage category	III
Rated impulse voltage	800 V
Level of contamination	2
Method of operation	Type 1
Degree of protection	IP20
Ambient temperature	0..55 °C
Ambient humidity	20..80 % r.h., non-condensing
Mounting	TH 35x7.5 top hat rail in closed housing. This device is intended for installation in a wall-mounted enclosure or switch cabinet with protection class I or II.
Weight	0.141 kg
Dimensions	WxHxD: 71.8 x 90 x 60 mm






Product description

BMA0600

Connection terminal

- Spring-loaded terminals, printers
- All terminals can be inserted with conductor end sleeves of 10 mm length
- Twisting two conductors is not permitted, twin wire-end ferrules can be used

	Input terminals  Terminal 21..32 and 51..56	Support terminals  Terminal 81..86 and 91..96	Bus terminals  Terminal 17..20
Stripping length	8..9 mm	10 mm	10 mm
Conductor cross section Solid conductor	0.2..1.5 mm ²	0.08..1.5 mm ²	0.2..1.5 mm ²
Conductor cross section Fine-stranded conductor	0.25..1.5 mm ²	0.08..1.5 mm ²	0.25..1.5 mm ²
Conductor cross section Fine-stranded conductor with ferrule	0.25..0.75 mm ²	0.8..1.5 mm ²	0.25..0.75 mm ²
Recommended crimp	square hexagonal	square hexagonal	square hexagonal

Sensor Types


Sensor type	Measuring range
0(2) V..10 V	0..100 %
KP10	-50..+150 °C
KP250	-50..+150 °C
ML2	-50..+150 °C
Ni100	-50..+150 °C
Ni1000 (DIN)	-50..+150 °C
Ni1000 (L&G)	-50..+150 °C
NTC1,8K	-50..+150 °C
NTC5K	-50..+150 °C
NTC10K	-40..+150 °C
NTC10KPRE	-40..+150 °C
NTC20K	-30..+150 °C
PT100	-100..+850 °C
PT1000	-100..+850 °C
Balco500	-40..+150 °C
Satchwell DC1100	-20..+120 °C
Satchwell DC1400	-40..+120 °C
Resistor (potentiometer)	0..500 kΩ



NOTE

You can find more information on the sensor types in the “Temperature Sensor Tables” product description (1.10-90.100-01).

Dimensions

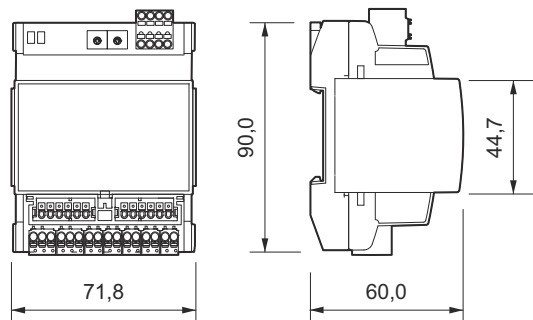

Connection




NOTE

The devices have galvanic isolation between the bus voltage supply and the input. This is a separation of duties that prevents unwanted ground loops.

Thanks to this functional separation, each module can provide its own ground plane that structurally prevents mass loops and potential shifts between the modules.

If the system layout requires it, however, the ground planes of the modules can also be connected without any issues.


- Two support terminal blocks for terminals “81” to “86” and terminals “91” to “96”

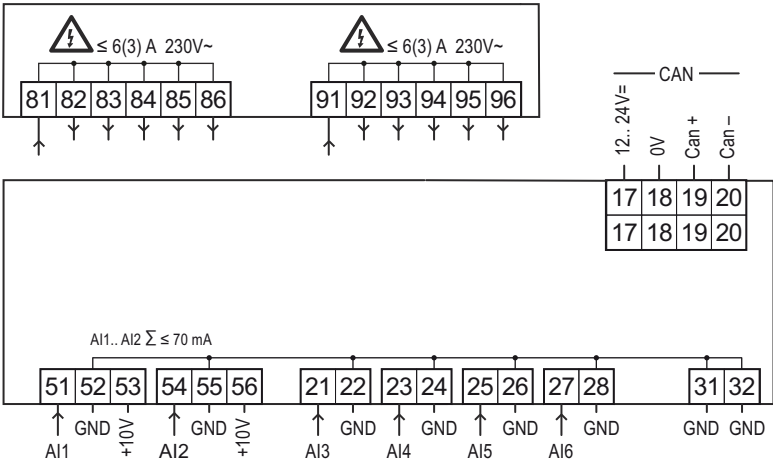




Product description BMA0600


DDC4000e connection

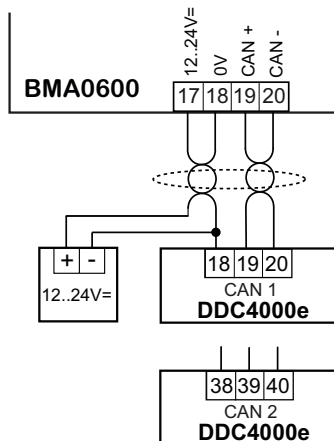

Sensor connection

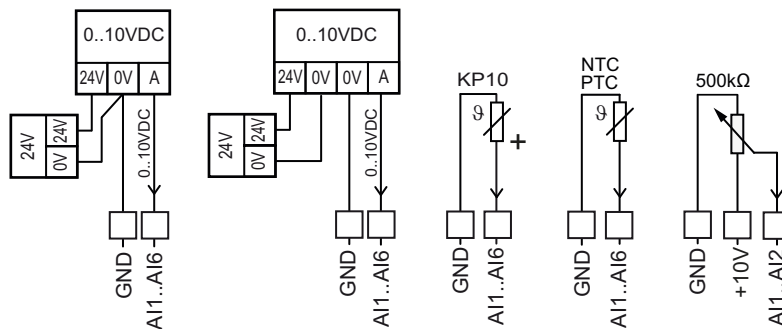

- Connection of several input/output modules via CAN bus

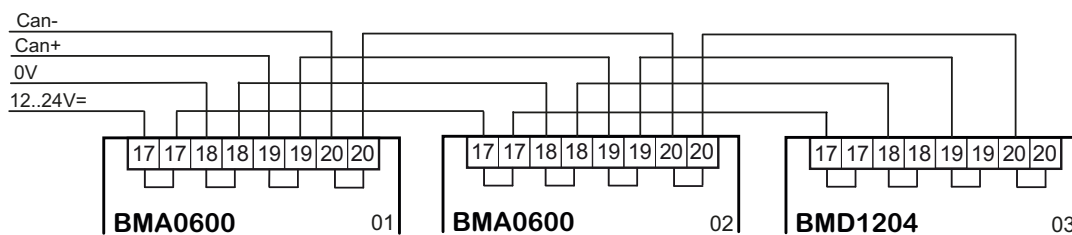

NOTE

The terminal block terminal “17” through terminal “20” (feed-through terminals) can be inserted and disconnected without interruption.



Installation



CAUTION

This product description contains the specific settings and functions of the input module. In addition to these instructions, the product descriptions of other system components, such as the automation station, are to be observed.



CAUTION

Switching on the power supply of unparameterized products can lead to unforeseen consequences such as malfunctions or material damage.

Switch on the power only after the device has been configured by the commissioning technician.



NOTE

The input module can be connected to an existing field bus or switch cabinet bus.
Further information can be found in the DDC4000 project planning documentation.

Switch cabinet bus

When connecting the switch cabinet bus, use a cable of at least type JY(St)Y 2x2x0.8 Lg: two x two leads stranded into a pair, plastic insulation and an electrostatic shield with a lead diameter of at least 0.8 mm. Use a stranded pair of leads for the data lines (+ and -) and another free lead for the ground (0).

At the end of the switch cabinet bus (farthest point from the DDC controller), install a terminating resistor of about 180 ohms between both data lines (+ and -). The terminating resistor is included with the DDC controller

The maximum cable length for the switch cabinet bus is 200 m.

Fieldbus

When connecting the fieldbus, use a cable of at least type JY(St)Y 2x2x0.8 Lg: two x two wires, twisted to a pair with plastic insulation and an electrostatic shield with a wire diameter of at least 0.8 mm. Use a stranded pair of wires for the data lines (+ and -) and another free wire for the ground connection (0).

At the end of the fieldbus (furthest point from the DDC controller), install a terminating resistor of about 180 ohms between both data lines (+ and -). The terminating resistor is included with the DDC controller.

The maximum cable length for the Fieldbus is 2000 m.







Mounting










WARNING

Contact with live parts of electrical domestic installation can cause death due to electric shock.
Mounting/removal may only be carried out when power is switched off.



Removal





Function and Operation



- (1) Combi LED (green, red) CAN bus
- (2) Address switch
- (3) Status LEDs of inputs
- (4) freely parameterizable LEDs

Parameterization

The following functions are defined via parameterization:

- Analog inputs can be configured according to the sensor type table



NOTE


Parameterization is retained in the event of a power failure.
Set address 99 to delete the parameterization.

Setting CAN Bus Address

Permitted range for the switch cabinet bus address: 01..63.

Permitted range for fieldbus address: 01..63.

- ▶ Set the first number of the bus address on the address switch, the second number on the second rotary address switch.
The example shows the address 15.





NOTE

In the delivery state, the address is set to "00", meaning:

- no bus communication
 - no parameterization possible
 - sensor inputs in test mode
-

Commissioning



CAUTION

Commissioning by switching on the supply voltage may occur only after the commissioning technician/engineer has finished configuring the DDC and has set the bus address.

- Parameterization is described in the project planning documentation for the automation station.
- Before switching on the supply voltage, check the electric installation and the device connections.
- After configuring the device and switching on the supply voltage, check the functions of the module and the connected inputs.

Functional test

It is possible to check the correct wiring and function of the inputs.

- ▶ Set the bus address "00".
- The correct polarity and wiring of the 8 inputs AI1 to AI6 can be checked with a diode and a resistor 180 Ω (series connection).

Target display:

- Open contact: Red LED
- Resistance diode combination correctly poled: Green LED

Possible wiring errors:

- Open contact: Green LED
- Resistance diode combination connection: Red LED



LED displays

LED CAN Bus

LED status (combination LED)	Meaning	Cause
off	Module not in operation	No operating voltage or operating voltage too low
Yellow on (green LED and red LED on)	Module in operation, but there is a bus error no CAN communication possible, module not logged on	Bus line short circuit (with respect to ground or each other), Bus lines reversed or interrupted
	Address 00 (manual operation effective, functional test possible)	
Yellow flashing (green LED and red LED flashing simultaneously) Flashing rate 1 sec.	Address error, no bus activity	Outside of address range #01..#63 address assigned multiple times
Green flashes and red LED off	Module OK, bus activity	
Red LED and green LED flash alternately slowly Flashing rate 6 sec.	Update is being transferred from DDC4000e to module	
Red LED permanent light	Address 99 (deleting the configuration, manual control effective)	

Status LED of the inputs

- Sensor value valid: LED lights up green
- Sensor value outside the measuring range: LED lights up red
- No sensor (sensor type) configured: LED off
- Negative voltage at the input falsifies the measuring signal: all input LEDs light up red.
The affected input flashes red.
- The +10 V DC auxiliary voltage breaks down. Caused by incorrect wiring:
LEDs of the 0/2..10 V DC inputs lights up red.



Product description
BMA0600